



TX-I/O™

Island bus expansion module

TXA1.IBE

-
- Expand island bus to a distance of up to 2 x 200 meters
 - Compact design per DIN 43 880, requires little space
 - Easy installation and setup
 - Mounted on standard rails
 - Self-connecting bus (island bus) for the easiest possible installation
 - Plug-in screw terminals for island bus expansion
 - No programming / parameterization tool required

Function

- The island bus expansion modules allow for “decentralized” sub-islands with TX-I/O-modules, that may be located up to 2 x 200 m from the "local" sub-island.
- A programming / parameterization tool is not required.
- The DIP switches for the bus master and bus terminator must be set correctly on the island bus expansion modules.
- The island bus expansion is based on differential RS-485 transmission technology.
- "Decentralized" sub-island can be supplied using a separate power supply. Loss of this power does not impact the island bus of local sub-islands.

For details on wiring and topology, refer to TX-I/O™ engineering and installation manual, CM110562.

Type summary

Island bus expansion module **TXA1.IBE**

Ordering

When ordering, please specify the quantity, product name, and type code.

Example:

10 Island bus expansion modules **TXA1.IBE**

Equipment combinations

Compatibility

Full functionality is only possible using

- TX-I/O modules from series C and higher
- P-bus interface modules series B and higher
- PXC-NRUD Series C and higher only (Migration – INTEGRAL AS1000)
- All models of PROFINET BIM

Functionality is reduced when using modules for series B and BIM series A: refer to CM110562.


System restrictions

Number of decentralized sub-islands per I/O island	Max. 8
Number of island bus expansion modules per decentralized sub-island	Exactly 1
Number of I/O modules per I/O island	Maximum of 64
Number of I/O modules per sub-island	No limit, as long as the total of the entire island (64) is maintained.

Island bus and island bus expansion are designed for indoor use in one building only.

See TX-I/O engineering and installation manual, CM110562 for more details.

Overview

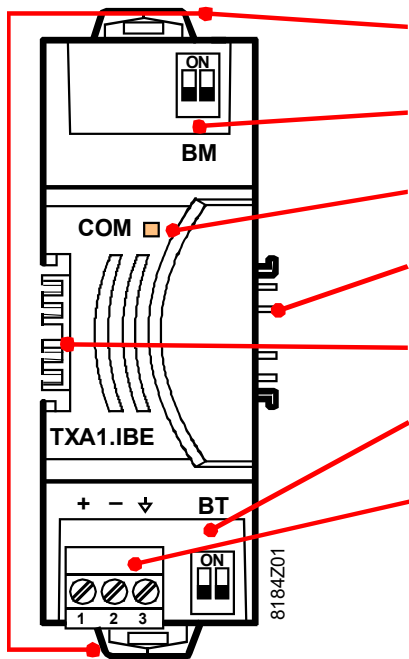

- Attachment slider for standard rails
- BM DIP switch *) for bus master (island bus)
- LED "COM", displays island bus communication
- Bus connector right
- Bus connector left
- BT DIP switch *) for bus terminal (island bus expansion)
- Plug-in screw terminals
 - + Signal island bus expansion
 - Signal island bus expansion
 - ⚡ equipotential bonding

*) DIP switch:

Both "BM" switches must have the same position.

The same applies to "BT" switches.

For details on wiring and topology, refer to TX-I/O™ engineering and installation manual, CM110562.

Mechanical properties

- The housing complies with DIN 43880 and is 32mm wide.
- The island bus expansion module is plugged on the right side of the power module / bus connection module on the standard rail. The electrical connection is on the 4 side island bus contacts. The bus establishes its own connection, when TX-I/O™ devices are plugged into one another on the rails.

Electrical properties

Interfaces

- **Island bus expansion:** Plug-in screw terminals
- **Island bus:** Bus connector on the right and left side of the module.

System ground

- Island bus and island bus expansion are galvanically connected

Protection against incorrect wiring

- All terminals are protected against short circuit and incorrect wiring using AC/DC 24 V.
- This applies as well to reverse phase voltage AC 24 V
- **Side bus connector: No protection**




Signaling

LED "COM" (yellow)

The LED indicates bus traffic on the island bus:

- Both directions OK: irregular blinking
- Bus short circuit: bright ON

Schematic

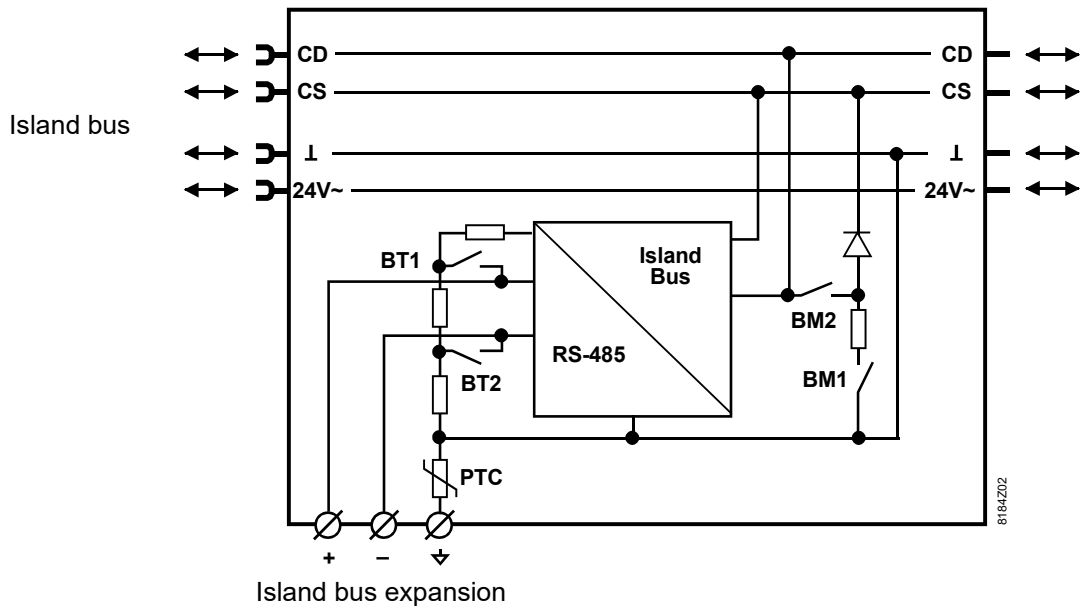

Engineering, topology

- Please consult the following document:
TX-I/O™ engineering and installation manual, CM110562.
- Island bus and island bus expansion are designed for indoor use only

Mounting

Fixings

The device is mounted on a standard rail 35 x 7.5 mm (tophat rails TH35-7.5 per EN60715)

Mounting order

An island bus expansion module can be placed anywhere in the I/O row. For signal quality reasons, however, the best place is directly after the supplying device (automations station, power supply module, bus connection module or bus interface module).

See also the connection examples on pages 7 and 8.

Exchange

An island bus expansion module may be removed from the row. **The electronic component from the neighboring right module must, however, be removed.** Its terminal block may remain.

Permissible mounting positions

TX-I/O™ devices can be mounted in any position: horizontally, vertically, on a horizontal surface.

You must ensure, however, that sufficient ventilation is available to maintain the permissible ambient temperature (max. 50°C).

Disposal



This symbol or any other national label indicates that the product, its packaging, and, where applicable, any batteries may not be disposed of as domestic waste. Delete all personal data and dispose of the item(s) at separate collection and recycling facilities in accordance with local and national legislation. For additional details, refer to www.siemens.com/bt/disposal.

Technical data

Supply (bus connector on side)	Operating voltage range	DC 21.5...26 V (SELV / PELV) or DC 24 V class 2 (US)
	Max. power consumption <i>(for the sizing of power supplies, see CM110562)</i>	1.2W
Maximum distances <i>(only with TX-I/O modules series C and higher; only with BIM Series B and higher)</i>	Island bus expansion	Max. 2 x 200 m
	Island bus inside of a sub-island (depending on cross section and current load – for details, refer to TX-I/O™ engineering and installation manual, CM110562)	Max. 50 m with round cable Max. 100 m with RG-62
	Bus expansion modules per I/O island	Max. 9 modules
	I/O modules per I/O island	Max. 64 modules
Island bus communication	Island bus traffic display	LED "COM"
	Bus master function	2 DIP switches "BM" = ON
	Bus terminator function (terminator)	2 DIP switches "BT" = ON
Galvanic isolation	Island bus and island bus expansion are galvanically connected via PTC (Conductors \perp and \blacktriangledown).	
Short-circuit protection and incorrect wiring	Side bus connector	No protection!
	Terminal	See below
Cabling	For details on cabling for RS485 and wiring rules, refer to TX-I/O™ engineering and installation manual, CM110562.	
Connection terminals, plug-in, for island bus expansion	Mechanical design	Plug-in screw terminal
	Copper wire	1 x 0.6 mm \varnothing to 2.5mm ² or 2 x 0.6 mm \varnothing to 1.0 mm ²
	Copper stranded wires with ferrules	1 x 0.6 mm \varnothing to 2.5mm ² or 2 x 0.6 mm \varnothing to 1.0 mm ²
	Copper stranded wires without ferrules	1 x 0.6 mm \varnothing to 2.5 mm ² or 2 x 0.6 mm \varnothing to 1.5 mm ²
	Screwdriver	Flat screwdriver size 1 with <i>shaft</i> $\varnothing \leq 4.5$ mm
	Maximum stud torque	0.6 Nm
Classification per EN 60730	Function of automatic control devices	Type 1
	Degree of pollution	2
	Mechanical design	Protection class III
Housing type	IP class per EN 60529	
	Front parts in DIN excerpt terminal part	IP30 IP20


Ambient conditions	Operation		As per IEC/EN 60721-3-3
	Climatic conditions		Class 3K23
	Temperature		-5...50 °C
	Humidity		5...95 % r.h.
Standards, directives and approvals	Mechanical conditions		Class 3M11
	Transport / Storage		
	Climatic conditions		As per IEC/EN 60721-3-2 /-3-1
	Temperature		Class 2K12 / 1K22
	Humidity		-25...70 °C
	Mechanical conditions		5...95 % r.h. Class 2M4
Standards, directives and approvals	Product standard	EN 60730-1	Automatic electrical controls for household and similar use
	Electromagnetic compatibility (Applications)		For use in residential, commercial, light-industrial and industrial environments
	EU conformity (CE)		See EU declaration of conformity *)
	UL certification (US)		UL 916, UL 864, http://ul.com/database
	CSA certification		Class 3862 , Class 4812 https://www.csagroup.org/testing-certification/product-listing/
	RCM-conformity (EMC)		See RCM declaration of conformity*)
Environmental compatibility	EAC conformity		Eurasia conformity
	Product environmental declaration (contains data on RoHS compliance, materials composition, packaging, environmental benefit, disposal)		CM2E8184 *)
Color	Top / bottom		2003 Ti-Grey / 804 Black
Dimensions	Housing as per DIN 43880, see dimensions		
Weight	Without / with packaging		64 / 84 g

*) The documents can be downloaded from <http://siemens.com/bt/download>.

See TX-I/O engineering and installation manual, CM110562 for more details.

A) Maximum 2 segments of max. 200 meters each are possible using the island bus expansion modules

A)

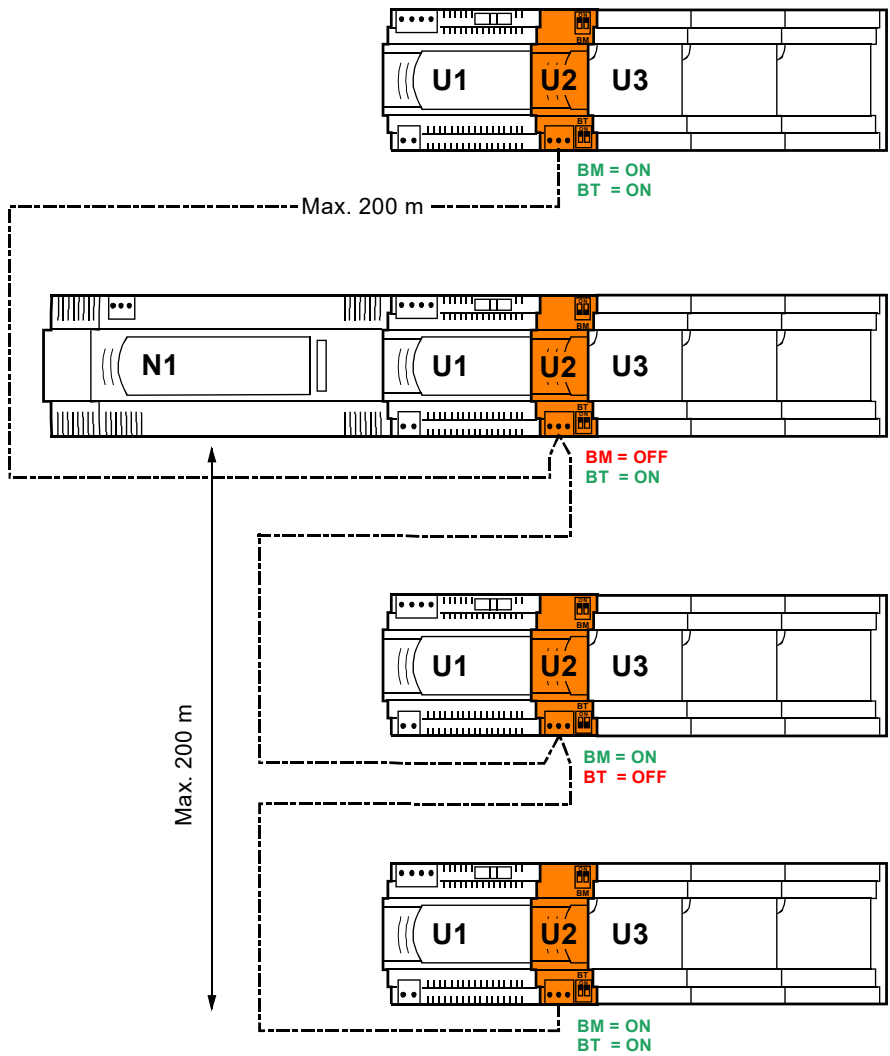


Key

- N1 Automation station with island bus or PROFINET BIM
- U1 Power supply module
- U2 Island bus expansion module
- U3 TX-I/O modules
- X1 Bus connection module
- BM Bus master function (island bus, both switches in the same position!)
- BT Bus terminator function (island bus expansion, both switches in the same position!)

B) Decentralized sub-island without power supply module (maximum distance depends on current on conductors CS and \perp)


B)

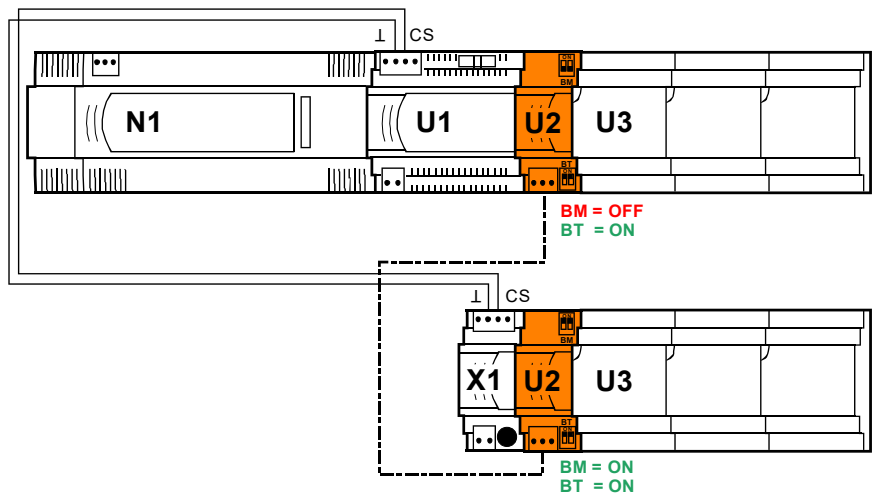

8184A01e

See TX-I/O engineering and installation manual, CM110562 for more details.

C) Maximum 2 segments of max. 200 meters each are possible using the island bus expansion modules

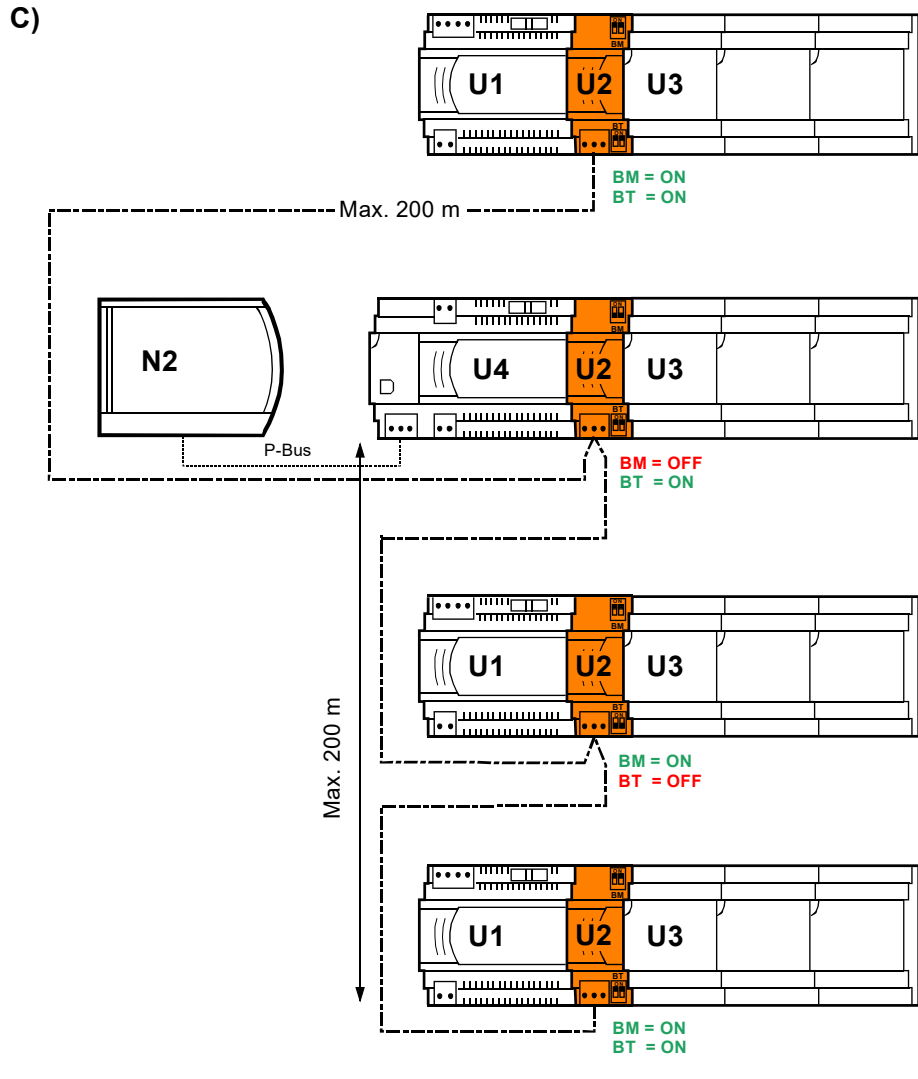


Key

- N2 Automation station with P-bus
- U1 Power supply module
- U2 Island bus expansion module
- U3 TX-I/O modules
- U4 P-bus interface module
- X1 Bus connection module

- BM Bus master function (island bus, both switches in the same position!)
- BT Bus terminator function (island bus expansion, both switches in the same position!)


D) Decentralized sub-island without power supply module (maximum distance depends on current on conductors CS and ⊥)

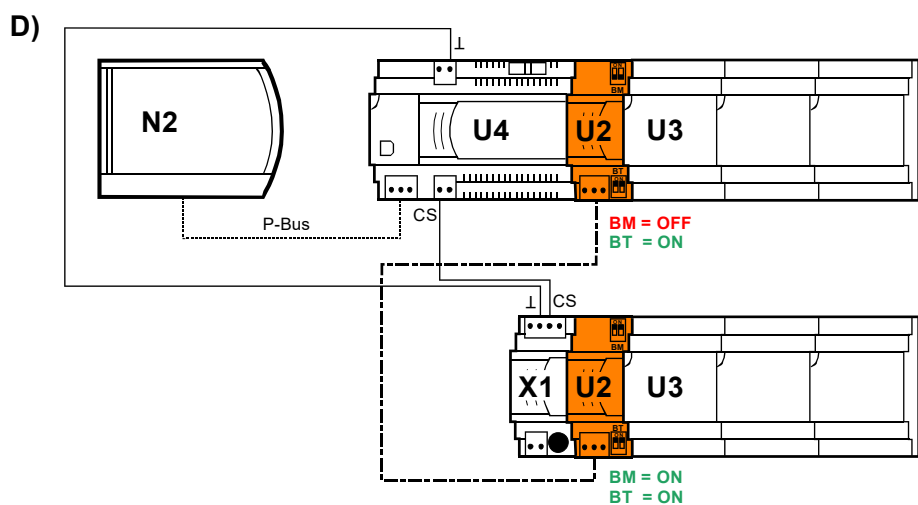

8184A11b

Dimensions

Dimensions in mm

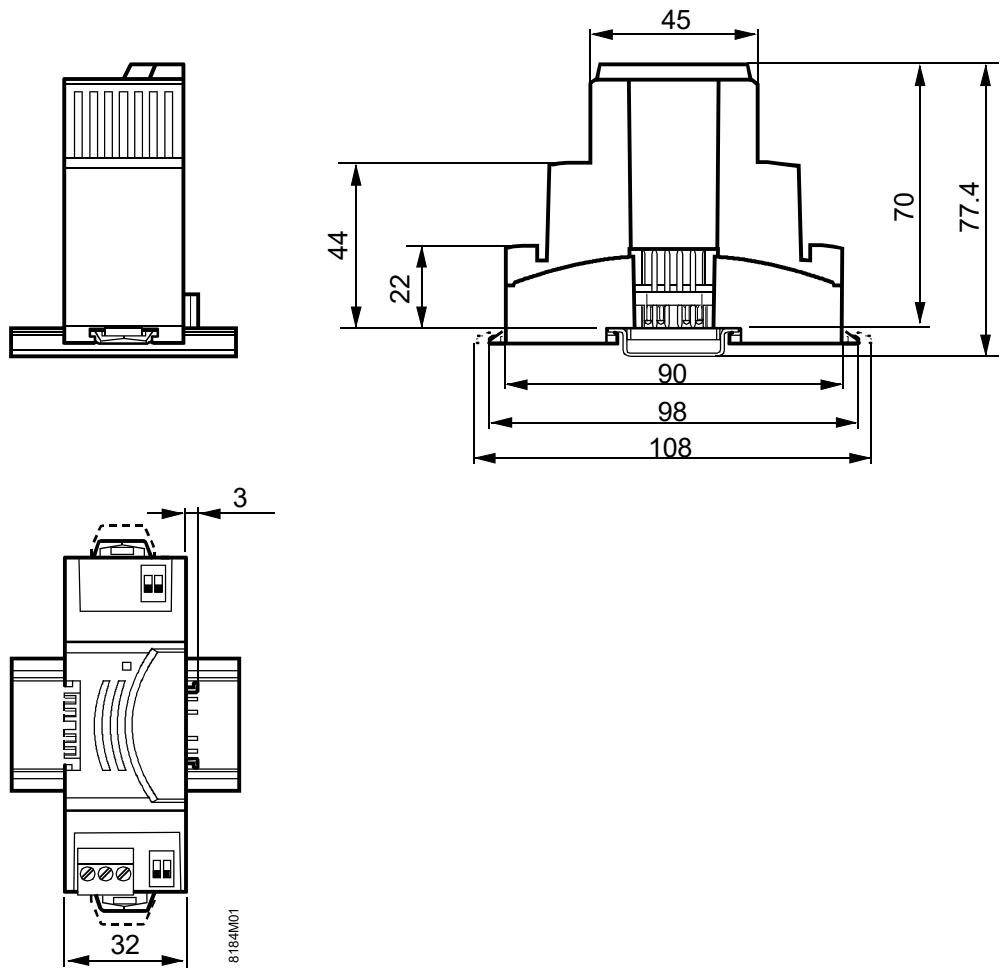

Issued by
Siemens Switzerland Ltd
Smart Infrastructure
Global Headquarters
Theilerstrasse 1a
CH-6300 Zug
Tel. +41 58 724 24 24
www.siemens.com/buildingtechnologies

© Siemens Switzerland Ltd 2012
Technical specifications and availability subject to change without notice